

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND DYED WATER TESTING FORM		Page <u>1</u> of <u>3</u>
Sewershed: Dundalk	Consultant: RJN Group, Inc.	Date: YYYYMMDD <u>2008 10 15</u>
Test to be performed: Smoke <input checked="" type="checkbox"/> Dye <input type="checkbox"/>	Ground Condition: <input checked="" type="checkbox"/> Dry <input type="checkbox"/> Damp <input type="checkbox"/> Wet	Supervisor initials: <u>TS</u>
Manhole ID: <u>S65Q-007MH</u>	Test ID: 1047- <u>174</u>	Notifications - made daily: <input checked="" type="checkbox"/> (Residents, Fire, 311)

Field Sketch: Show all manholes with numbers, blower placement location, sandbag or isolation device location, street names, building addresses and locations, defect locations and photograph numbers.

Hand-drawn field sketch on a grid background. A vertical line represents "Anglesea St". To the left of the street, three house icons are drawn, with addresses "1403", "1405", and "1405" written vertically next to them. To the right of the street, two manholes are marked with circles and labeled "S65Q-006MH" and "S65Q-007MH". Arrows point from the text "sand BAGS" to each manhole. Below the second manhole, an arrow points to the text "Smoke Blower".

**ringroup**

Date: YYYYMMDD

Supervisor initials: TS

Notifications - made daily: ☒  
(Residents, Fire, 311)

**Field Sketch:** Show all manholes with numbers, blower placement location, sandbag or isolation device location, street names, building addresses and locations, defect locations and photograph numbers.

SAND BAGS

Sand Bags  
+  
Air Blower

# ringroup

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND  
DYED WATER TESTING FORM

Page 2 of 3

Sewershed: Dundalk

Consultant: RJN Group, Inc.

Date: YYYYMMDD

2008/09/15

Test to be performed:

Smoke ☒ Dye ☐

Ground Condition:

☒ Dry

☐ Damp

☐ Wet


Supervisor initials: TS

Manhole ID: S65Q-006MH

Test ID: 1047- 174

Notifications - made daily: ☒  
(Residents, Fire, 311)

Field Sketch: Show all manholes with numbers, blower placement location, sandbag or isolation device location, street names, building addresses and locations, defect locations and photograph numbers.

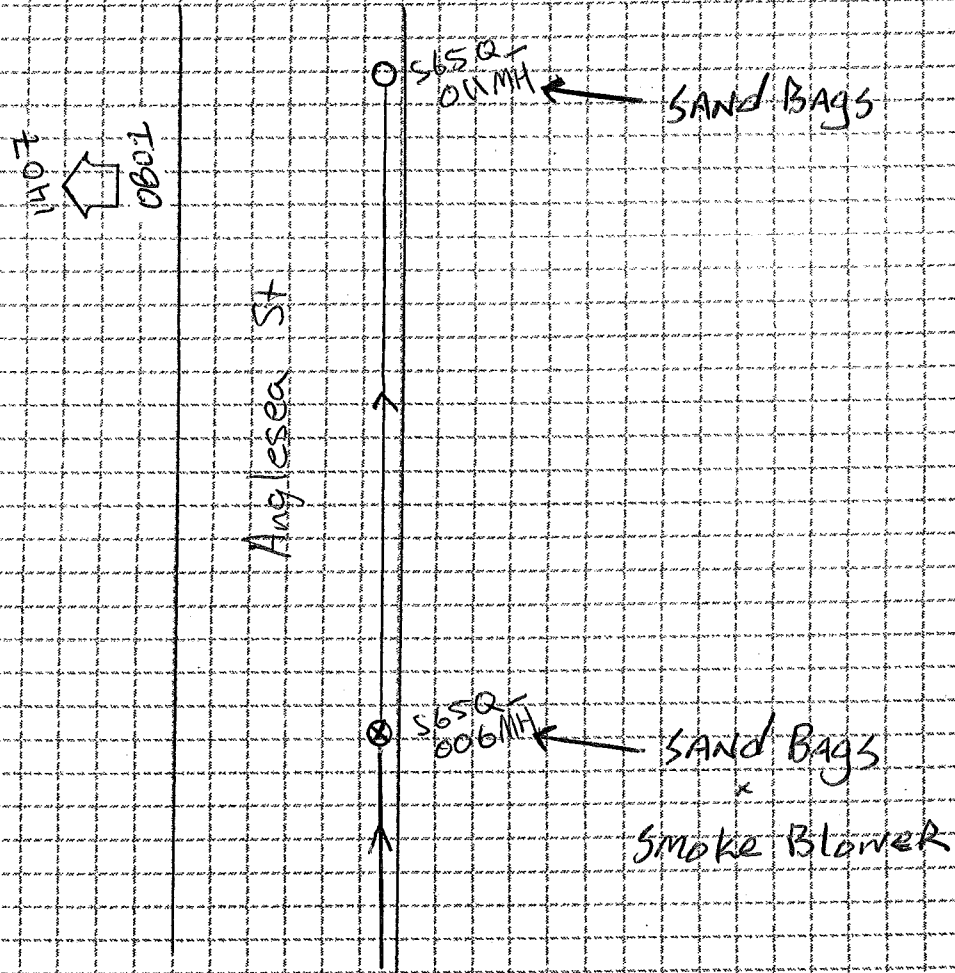

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND DYED WATER TESTING FORM		Page <u>1</u> of <u>3</u>
Sewershed: Dundalk	Consultant: RJN Group, Inc.	Date: YYYYMMDD <u>2008 10 15</u>
Test to be performed: Smoke <input checked="" type="checkbox"/> Dye <input type="checkbox"/>	Ground Condition: <input checked="" type="checkbox"/> Dry <input type="checkbox"/> Damp <input type="checkbox"/> Wet <input type="checkbox"/>	Supervisor initials: <u>TS</u>
Manhole ID: <u>S65Q-007MH</u>	Test ID: 1047- <u>174</u>	Notifications - made daily: <input checked="" type="checkbox"/> (Residents, Fire, 311)



1047-174-OB02-P01 Private Lateral,  
medium smoke, grass.



1047-174-OB03-P01 Private Cleanout,  
heavy smoke, grass.



1047-174-OB04-P01 Private Cleanout,  
medium smoke, grass.



CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND DYED WATER TESTING FORM		Page <u>2</u> of <u>3</u>
Sewershed: Dundalk	Consultant: RJN Group, Inc.	Date: YYYYMMDD <u>2008/09/15</u>
Test to be performed: Smoke <input checked="" type="checkbox"/> Dye <input type="checkbox"/>	Ground Condition: <input checked="" type="checkbox"/> Dry <input type="checkbox"/> Damp <input type="checkbox"/> Wet	Supervisor initials: <u>TS</u>
Manhole ID: <u>565R-006MH</u>	Test ID: 1047- <u>174</u>	Notifications - made daily: <input checked="" type="checkbox"/> (Residents, Fire, 311)



1047-174-OB01-P01 Private Cleanout,  
medium smoke, grass.